
CANADA WATER AERODROME SUPPLEMENT

Effective 0901Z 19 March 2026 to 0901Z 18 February 2027

GANGES BC CAX6

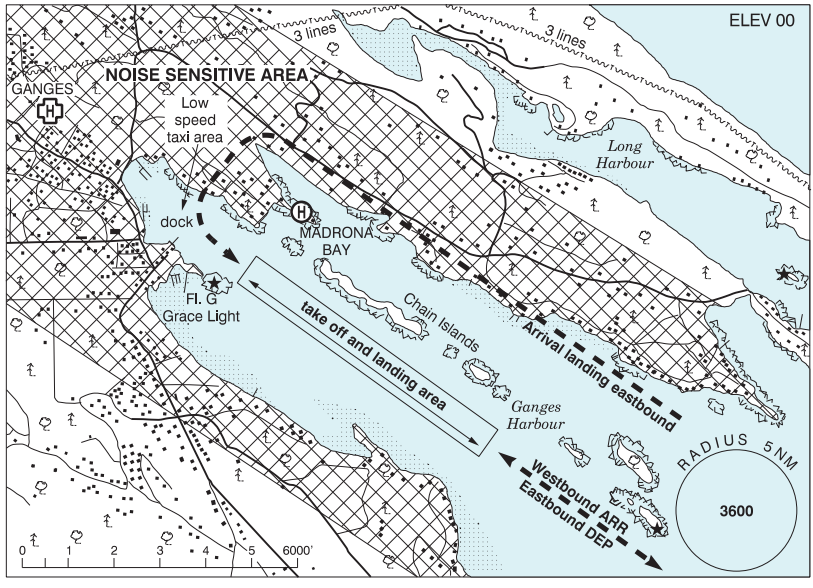

REF	N48 51 00 W123 30 00 1SE 17°E (2013) UTC-8(7) Elev 00′ VTA A5004
OPR	Salt Spring Harbour Authority 250-537-5711 Reg PN Ldg fees
PF	C-1,2,3,4,5,6
FLT PLN **FIC**	Kamloops 866-WXBRIEF (Toll free within Canada) or 866-541-4101 (Toll free within Canada & USA)
SERVICES **S**	4 (PPR)
A/D DATA	Tidal range 12′. Cond rpt avbl 250-537-5711 17-01Z‡, 17-21Z (winter).
COMM **ATF**	tfc 123.2 2NM 1200 ASL

GANGES BC (Cont'd) CAX6

PRO

GENERAL

1. For acft type and operating requirements, ctc opr 250-537-5711. PN
2. Acft opr should refrain fr taking off and ldg prior to 0700.
3. When wind & water cond permit, pilots should use the following pro.
4. For noise abatement, the preferred arr direction is westbound, and eastbound for dep. Avoid overflights of the built up areas of Saltspring Island whenever possible to reduce the noise impact on the hospital, school & residents.

ARRIVALS

WESTBOUND: Land westbound and be off the step by Grace Light.
EASTBOUND: When possible, use a steep/high apch profile with reduced power to reduce noise over the hospital. Touchdown abeam or beyond Grace Light. Land short in the low speed taxi area only when rough water cond preclude ldg abeam Grace Light.

DEPARTURES

EASTBOUND: Taxi to abeam or beyond Grace Light prior to commencing tkof. After tkof, reduce power as soon as practicable & climb in an easterly direction to 500' ASL or above before commencing any turns.
WESTBOUND: Westbound tkof are not recommended as severe downdrafts may be encountered in strong westerly winds over the head of the Harbour & town.

NOTE: For acft planning flts to the W after departure, make initial climb to the E to 500' ASL or above before commencing any turns. Plan flts so as to avoid overflight of noise sensitive areas below 2000' ASL.

CAUTION

1. NORDO acft may opr fr the nearby Booth Bay & Fernwood land A/Ds.
2. Heavy vessel tfc & recreational water activities in the Harbour particularly dur the sum. Crab pots freq in harbour.
3. Marked p-line near the hospital at the head of the Harbour.

GARDEN BAY / SAKINAW LAKE SOUTH BC CAS8

REF N49 39 13 W124 03 50 1.8NNW 16°E (2024) UTC-8(7) Elev 20′ A5004

OPR M Aidelbaum 604-671-1701 Reg PPR


PF B-2,7,8 C-1

FLT PLN
FIC Kamloops 866-WXBRIEF (Toll free within Canada) or 866-541-4101 (Toll free within Canada & USA)

SERVICES
S 6,7

A/D DATA Open water year round. Dock, buoy.

COMM
ATF tfc 123.2 2NM 1600 ASL

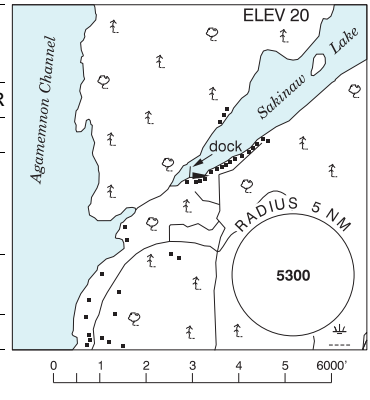

GIBSON LAKE ON — See BALA / GIBSON LAKE